

Original Article: Improving the Transient Stability of a Synchronous Generator by Using Braking Resistance to Increase the Critical Clearing Fault Time

Ebadollah Amouzad Mahdiraji*

Department of Engineering, Sari Branch, Islamic Azad University, Sari, Iran



Citation E.A. Mahdiraji*, **Improving the Transient Stability of a Synchronous Generator by Using Braking Resistance to Increase the Critical Clearing Fault Time** *Eurasian J. Sci. Tech.*, 2021, 1(1), 40-47.

doi <https://doi.org/10.22034/ISTR.2021.285385.1019>



Article info:

Received: 08 January 2021

Accepted: 31 April 2021

Available Online: 14 May 2021

ID: JSTR-2105-1019

Checked for Plagiarism: Yes

Peer Reviewers Approved by:

Dr. Amir Samimi

Editor who Approved Publication:

Prof. Dr. Abdulkareem M. A. Alsammaraie

Keywords:

Critical Clearing Time, Transient Stability, Oscillation Damping, Dynamic Brake Resistance.

ABSTRACT

In general, the stability of the power system can be considered a feature of the system that enables it to remain in equilibrium under normal conditions and regain a different acceptable state if affected by disturbance. Instability in a power system may take many forms, depending on the composition of the system and its operating modes. In order to evaluate the proposed method in damping transient fluctuations and network stability, a study has been carried out on a typical network. Since the topic of the article is in the field of transient stability, in part of the paper, braking resistance modeling in transient stability studies has been investigated. In the section on brake resistor control, brake resistor control is introduced by a switched Thyristor, using the trapezoidal method. Finally, the simulation results of the studied network are presented with the presence of TCBR and its capability of damping in the desired network.

Introduction

In recent years, the use of FACTS as controllable components has increased the capacity of existing transmission lines, thus avoiding or at least delaying the need to install new lines that are often confined to economic and environmental reasons. In addition to increasing the capacity of the transmission system, the complementary controls added to these FACTS equipment

attenuates inter-region fluctuations [1-6]. Although power system stabilizers have been widely used to provide additional attenuation in inter-region oscillations of the power system, the potential of complementary damping controllers in FACTS devices has been confirmed than the power system stabilizers [7-9].

Modern power systems are large and complex systems that are exploited under economic pressures in a restructured competitive environment. These pressures cause the power system to operate under conditions very close

*Corresponding Author: Ebadollah Amouzad Mahdiraji (Ebad.Amouzad@gmail.com)

to the security limits that may not be well-identified. During normal operation of the power system, there is a balance between the mechanical power input to each power plant unit and the output electrical power plus loss. The problem arises when a sudden disturbance causes changes in the output of electrical power. These disorders can include events such as the occurrence of short circuits on lines or generator-connected chains. The magnitude of the disturbance is determined by the output power loss and sudden acceleration. Brake resistor is a high energy loss resistor in a short period that rapidly enters the circuit at the time of the fault such as a resistor load and absorbs accelerator energy generated by the fault and increases power consumption. A study [10] employed an approach based on the use of FACTS devices to improve the stability of power systems. For this purpose, using a conventional controller and a fuzzy logic controller based on braking resistance, the transient stability improvement of a synchronous generator in a single machine and then a multi-machine is investigated. Based on a previous study [11-13], a two-layer control structure, designated as a Thyristor-controlled braking resistor (BR) control system, was proposed for the operation of a multi-machine power system in transient conditions. In this method, multiple local physical controllers are introduced in the network load settings and power transfer modes after a severe disturbance on the rotor angle and rotor speed of each generator and the firing angle of each Thyristor controls the time and amount of BR. For the introduced case, the damping is increased and the stability margin is increased. The results obtained in this method show that the controller is capable of controlling the system when instability conditions are occurring. In another study [14], two different new brake models are presented, one involving a Thyristor rectifier and the other involving a combination of a diode rectifier and a cutter whose performance is compared with the current Thyristor controlled brake resistor. In this comparison, an index of speed performance of the number of components used, heat loss and harmonics simulation for each model is presented and the final model is introduced. The effectiveness of the proposed

method has been tested through Matlab/Simulink simulation concerning unbalanced and temporal errors in the power system. Also using Thyristor-controlled braking resistor and fuzzy logic has been used to increase transient stability in a multi-machine power system [15]. In this method, the time derivative of total kinetic energy deviation is used as a fuzzy controlled input for braking resistance switching. It is noted in this paper that the time derivative function as a controller input, to reduce installation costs as well as the computational burden, reduces the use of brake resistor numbers in appropriate locations rather than installing any braking resistor. The bus terminal becomes each generator. According to a study [16], two brake resistor models, one consisting of a Thyristor rectifier and the other consisting of a combination of a diode rectifier and a system breaker, are presented. In this case, their performance is compared with the existing braking resistance. In a study [17-22], it has been used to model and adjust the hydro turbine governor and design of dynamic braking resistors to improve transient stability in the generator. In the study, the dynamic braking resistance proposed by the combination of the existing governor regulator is used to improve the stability of the generator stability margin as a transient stability criterion. The simulation results show that the proposed method to avoid generator speeds exceeding the limit when a severe fault occurring in the power system can be avoided by removing all or part of the load.

Introducing the proposed network with TCBR presence

Brake resistance is a resistor that can be cut and connected with a Thyristor and its effective amount in the circuit can be changed. To investigate the presence of TCBR in the power grid, a typical grid is introduced as illustrated in Figure 1 [23-29], The target network is an infinite single-machine network, which is intended to investigate the presence of TCBR in the network. In the presented network, it is assumed that the TCBR is mounted on the generator bus to aid in the attenuation of possible fluctuations. An overview of the network studied is shown in Figure 1.

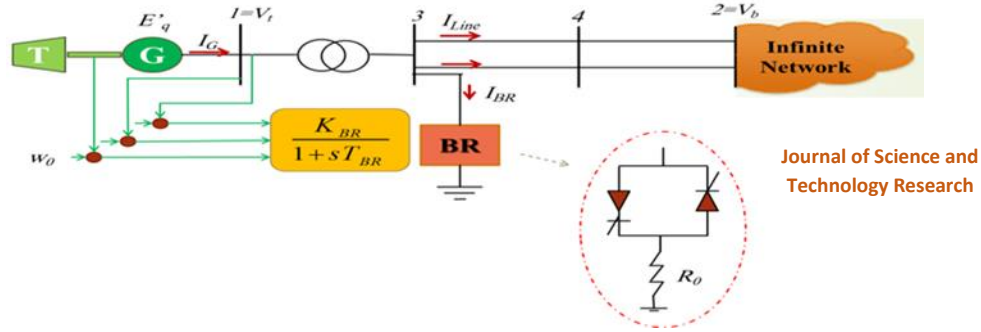


Figure 1. The studied network in the presence of TCBR

Braking resistance modeling in transient stability

of the introduced equations. Consider the network order shown in Figure 2.

The braking resistance modeling process is introduced to investigate the transient stability

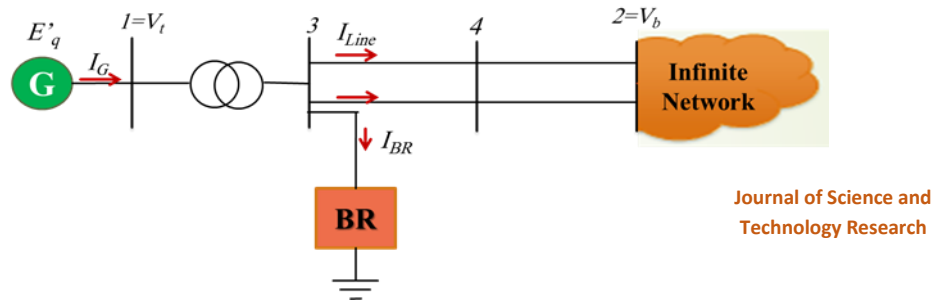


Figure 2. The target network with the presence of TCBR to study the transient stability

In accordance with Figure 2, we have:

$$I_L = I_{Line}$$

$$I_{BR} = I_{\text{Breaking Resistor}}$$

Network admittance matrix of the single machine connected to an infinite bus are:

$$(1) \quad I_{Bus} = Y_{Bus} V + G_{BR} U_k V \quad (2)$$

$$\begin{bmatrix} I_{Gb} \\ 0 \end{bmatrix} = \begin{bmatrix} Y_{11} & Y_{12} \\ Y_{21} & Y_{22} \end{bmatrix} \begin{bmatrix} V_{tb} \\ V_{34} \end{bmatrix} + G_{BR} \begin{bmatrix} U_{k1} & 0 \\ 0 & U_{k2} \end{bmatrix} \begin{bmatrix} V_{tb} \\ V_{34} \end{bmatrix}$$

Depending on the network, we have:

$$(3) \quad U_{k2} = \begin{bmatrix} 1 & 0 \\ 0 & 0 \end{bmatrix} \quad U_{k1} = \begin{bmatrix} 0 & 0 \\ 0 & 0 \end{bmatrix}$$

Reduced Network Admissions Matrix:

$$\begin{cases} I_{Gb} = Y_{11} V_{tb} + Y_{12} V_{34} + G_{BR} U_{k1} V_{tb} \\ 0 = Y_{21} V_{tb} + Y_{22} V_{34} + G_{BR} U_{k2} V_{34} \end{cases} \quad (4)$$

$$(5) \quad V_{34} = -[Y_{22} + G_{BR} U_{k2}]^{-1} Y_{21} V_{tb}$$

$$(6) \quad I_{Gb} = (Y_{11} + G_{BR} U_{k1}) V_{tb} - Y_{12} [Y_{22} + G_{BR} U_{k2}]^{-1} Y_{21} V_{tb}$$

$$(7) \quad I_{Gb} = [(Y_{11} + G_{BR} U_{k1}) - Y_{12} [Y_{22} + G_{BR} U_{k2}]^{-1} Y_{21}] V_{tb}$$

$$(8) \quad I_{Gb} = [Y_{11} - Y_{12} [Y_{22} + G_{BR} U_{k2}]^{-1} Y_{21}] V_{tb}$$

$$(9) \quad I_{Gb} = Y_R V_{tb}$$

$$(10) \quad \begin{bmatrix} I_G \\ I_b \end{bmatrix} = \begin{bmatrix} Y_{R1} & Y_{R2} \\ Y_{R3} & Y_{R4} \end{bmatrix} \begin{bmatrix} V_t \\ V_b \end{bmatrix}$$

$$(11) \quad I_G = Y_{R1} V_t + Y_{R2} V_b$$

(12)

$$I_d + jI_q = (G_{R1} + jB_{R1})(V_d + jV_q) + (G_{R2} + jB_{R2})(V_{bd} + jV_{bq})$$

(13)

$$\begin{cases} I_d = G_{R1}V_d - B_{R1}V_q + G_{R2}V_{bd} - B_{R2}V_{bq} \\ I_q = G_{R1}V_q + B_{R1}V_d + G_{R2}V_{bq} + B_{R2}V_{bd} \end{cases}$$

Finally, the matrix form of the equations is:

(14)

$$\begin{bmatrix} I_d \\ I_q \end{bmatrix} = \begin{bmatrix} G_{R1} & -B_{R1} \\ B_{R1} & G_{R1} \end{bmatrix} \begin{bmatrix} V_d \\ V_q \end{bmatrix} + \begin{bmatrix} G_{R2} & -B_{R2} \\ B_{R2} & G_{R2} \end{bmatrix} \begin{bmatrix} V_{bd} \\ V_{bq} \end{bmatrix}$$

Generator Equations:

$$(15) \quad \begin{cases} V_d = X_q I_q \\ V_q = E'_q - X'_d I_d \end{cases}$$

Matrix Form of Generator Equations:

$$(16) \quad \begin{bmatrix} V_d \\ V_q \end{bmatrix} = \begin{bmatrix} 0 & X_q \\ -X'_d & 0 \end{bmatrix} \begin{bmatrix} I_d \\ I_q \end{bmatrix} + \begin{bmatrix} 0 \\ 1 \end{bmatrix} E'_q$$

By pasting in the I_{dq} relation, we have:

(17)

$$[I - GBR1.XDQ].I_{dq} = GBR1.U.E'_q + GBR2.V_{bdq}$$

(18)

$$I_{dq} = [I - GBR1.XDQ]^{-1}.GBR1.U.E'_q + [I - GBR1.XDQ]^{-1}.GBR2.V_{bdq}$$

By embedding the I_{dq} relationship, we will have:

(19)

$$V_{dq} = U.E'_q + XDQ.[E.E'_q + H.V_{bdq}]$$

(20)

$$V_{dq} = U.E'_q + [XDQ.E].E'_q + [XDQ.H].V_{bdq}$$

(21)

$$V_{dq} = \underbrace{[U + XDQ.E].E'_q}_{YL} + \underbrace{[XDQ.H].V_{bdq}}_{YN}$$

Simulation output analysis on the sample network

In this section, a short circuit fault scenario is applied to the desired grid under the presented relationships and the ability of TCBR to dampen the oscillations of the synchronous generator is investigated. The parameters of the generator and transmission lines are considered by Table 1 and 2. Also, the information obtained from system load propagation studies is provided in Table 3 to obtain the starting point of the system [30-35],

Table 1. Generator parameter values and AVR control coefficients

Generator's Parameters		
X_d	Steady state direct-axis reactance	1.2
X_q	Steady state quadrature reactance	0.8
X_{pd}	Transient direct-axis reactance	0.2
H	Inertia Constant	5
T_{pdo}	Direct-axis transient short-circuit time constant	7
KA	AVR gain	100
TA	AVR time constant	1
f_0	System frequency	50

Table 2. Reactance values of line and transformer parameters

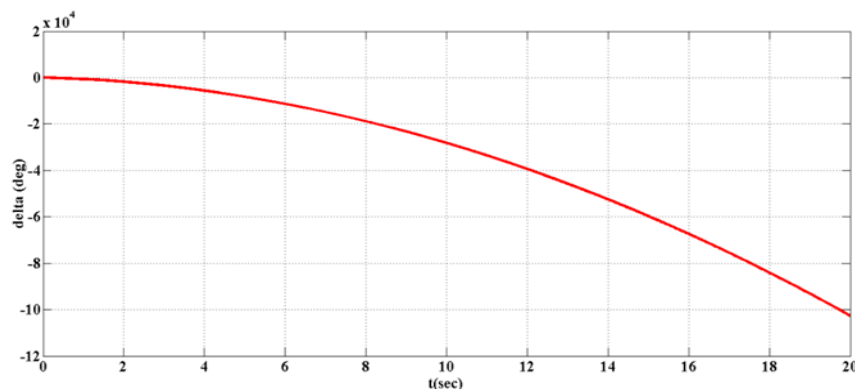
Network and Transformer's Parameters		
X_{l1}	Line reactance	0.2
X_{l2}	Line reactance	0.2
X_{l3}	Line reactance	0.2
X_{l4}	Line reactance	0.2
X_t	Transformer reactance	0.1


Table 3. Quantities obtained from load flow studies

Load Flow Analysis		
V_t	Terminal voltage	1.05
P_{e0}	Real power output of the machine	0.8
Q_{e0}	Reactive power output of the machine	0.6
W_0	Rated angular velocity	314.15927

As shown in Figure 2, it is assumed that a short circuit error on terminal 3 will somehow fluctuate for the generator fault. By the relationships introduced in this section, the TCBR control model is coded in the MATLAB software space. According to the program presented below, the generator angle and velocity fluctuations in the presence and absence of TCBR are presented. An overview of the generator angle and velocity fluctuations in exchange for the presence or absence of TCBR is given in Figures 3 to 6. According to Figures 3 and 4, it is observed that in the absence of TCBR


and with increasing time, angle and velocity both decrease and become unstable. Also, in Figures 5 and 6, it is observed that in the presence of TCBR, the time, angle and velocity decrease favorably. This section illustrates the ability of TCBR to dampen fluctuations. The results of the above simulations show that if the TCBR is used at the right time and optimally, the rotor angle fluctuations of the generators will be attenuated appropriately. It can be seen in this section that using a control element in the network can help attenuate the damping of the network [36-41].

**Figure 3.** Generator angle oscillation without the presence of TCBR

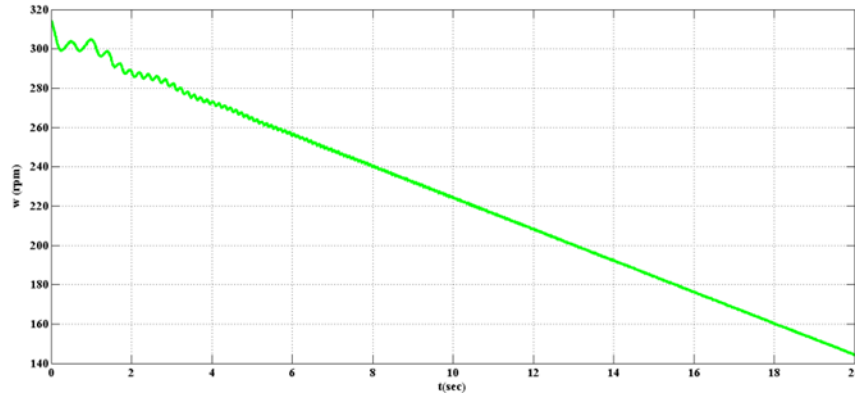


Journal of Science and
Technology Research

Figure 4. Generator speed oscillation without the presence of TCBR

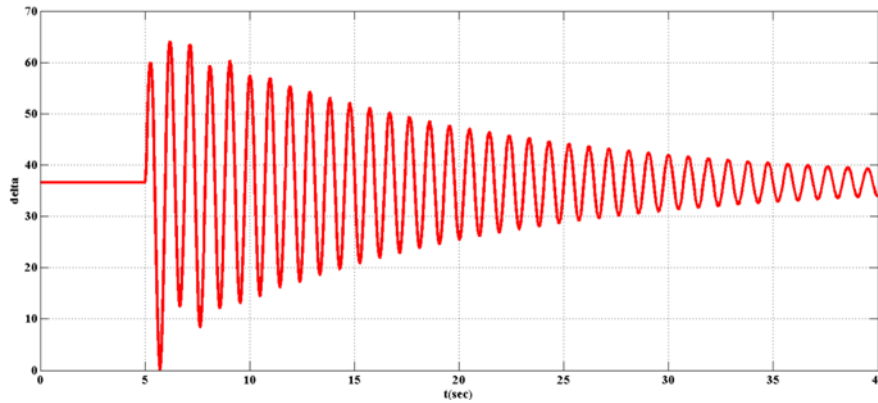

Journal of Science and
Technology Research

Figure 5. Generator angle oscillations in the presence of TCBR

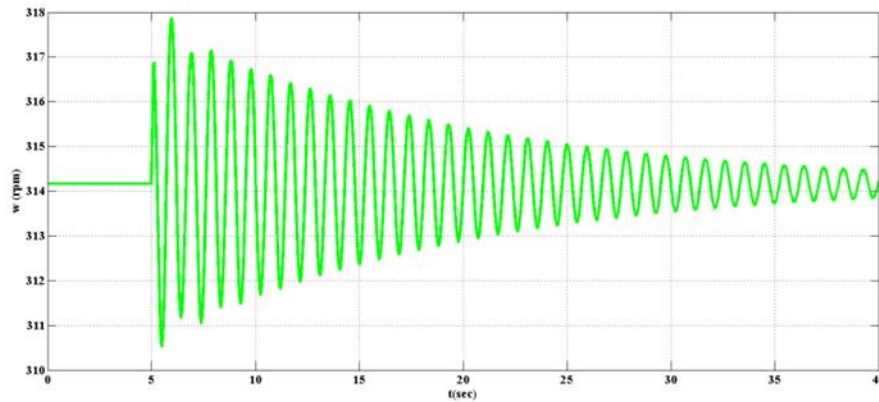

Journal of Science and
Technology Research

Figure 6. Generator speed oscillations in the presence of TCBR

Conclusion

In this paper, while introducing the different capabilities and applications of FACTS equipment in different areas, the proposed solution to reduce losses is to use FACTS controllers. Among these devices, the focus on a power flow controller called Dynamic Brake Resistance (TCBR) and its purpose is to investigate its impact and adjustment for

transient network stability. To investigate the impact of TCBR on transient stability studies, a suitable mathematical model has been described and an appropriate power injection model has been demonstrated to demonstrate its playability. The introduction of the TCBR model into the network understudy to perform optimum broadcast computation by MATLAB software was done by adding a virtual bus to the network. This virtual bus, which we

consider nb+1, was added to the Toolbox and the network equipped with this equipment was compared to TCBR-free. The analysis of the results shows that by adding a TCBR number to the studied network, the unstable fluctuations in the network have been desperately attenuated. In this regard, the most suitable location for IPC installation is to increase the attenuation of the system in the generator bus. The main advantages of the proposed method over the previous methods can be summarized in the simplicity of problem analysis and its formulation, satisfying all constraints of equality and inequality in achieving the optimal work point. Comparison of the proposed method with the work done in the field shows that, unlike previous methods, TCBR as a cheaper FACTS controller has increased network stability to a greater extent. At the same time, it offers other capabilities such as fault current limiting, independent control of active and reactive power, thereby increasing system flexibility.

Orcid

Ebadollah Amouzad Mahdiraji:

<https://orcid.org/0000-0003-3777-4811>

References

- [1] E.A. Mahdiraji, A.Y. Talouki, *Journal of Chemical Reviews*, **2021**, 3, 40-49. [[crossref](#)], [[Google Scholar](#)], [[Publisher](#)]
- [2] Z. Peng, J. Wang, D. Bi, Y. Dai, Y. Wen, *IEEE Trans. Sustain. Energy.*, **2018**, 9, 1157-1168. [[crossref](#)], [[Google Scholar](#)], [[Publisher](#)]
- [3] J. Morren, J. Pierik, S.W.H. de Haan, *Elect. Power Syst. Res.*, **2006**, 76, 980-987. [[crossref](#)], [[Google Scholar](#)], [[Publisher](#)]
- [4] E.A. Mahdiraji, A.Y. Talouki, *Journal of Chemical Reviews*, **2020**, 2, 284-291. [[crossref](#)], [[Google Scholar](#)], [[Publisher](#)]
- [5] N. Soni, S. Doolla, M.C. Chandorkar, *IEEE Trans. Power Del.*, **2013**, 28, 1830-183. [[crossref](#)], [[Google Scholar](#)], [[Publisher](#)]
- [6] E.A. Mahdiraji, S.M. Shariatmadar., *Advanced Journal of Science and Engineering.*, **2020**, 1, 27-31. [[crossref](#)], [[Google Scholar](#)], [[Publisher](#)]
- [7] J. Morren, S.W.H. de Haan, W.L. Kling, J.A. Ferreira, *IEEE Trans. Power Syst.*, **2006**, 21, 433-434. [[crossref](#)], [[Google Scholar](#)], [[Publisher](#)]
- [8] E.A. Mahdiraji, *Journal of Scientific Perspectives*, **2020**, 4, 245-254. [[crossref](#)], [[Google Scholar](#)], [[Publisher](#)]
- [9] Y. Wang, G. Delille, H. Bayem, X. Guillaud, and B. Francois, *IEEE Trans. Power Sys.*, **2013**, 28, 2412-2420,. [[crossref](#)], [[Google Scholar](#)], [[Publisher](#)]
- [10] E.A. Mahdiraji, M.S. Amiri, *Journal of Engineering Technology and Applied Sciences*. **2020**, 5, 133-147. [[crossref](#)], [[Google Scholar](#)], [[Publisher](#)]
- [11] F.D. Kanellos, N.D. Hatziargyriou, *IEEE Trans. Energy Convers.*, **2010**, 25, 1142-1151. [[crossref](#)], [[Google Scholar](#)], [[Publisher](#)]
- [12] M. Hwang, E. Muljadi, J.W. Park, P. Sorensen, Y.C. Kang, *IEEE Trans. Sustain. Energy*, **2016**, 7, 924-933. [[crossref](#)], [[Google Scholar](#)], [[Publisher](#)]
- [13] A. Surendar, A. Bozorgian, A. Maselena, L.K. Ilyashenko, M. Najafi, *Inorganic Chemistry Communications*, **2018**, 96, 206-210. [[crossref](#)], [[Google Scholar](#)], [[Publisher](#)]
- [14] M. Hwang, E. Muljadi, G. Jang, Y.C. Kang, *IEEE Trans. Power Sys.*, **2017**, 32, 1873 - 1881. [[crossref](#)], [[Google Scholar](#)], [[Publisher](#)]
- [15] A. Bozorgian, *Advanced Journal of Chemistry, Section B*, **2020**, 2, 91-101. [[crossref](#)], [[Google Scholar](#)], [[Publisher](#)]
- [16] T. Petru, T. Thiringer, *IEEE transactions on Power Systems*, **2002**, 17, 1132-1139. [[crossref](#)], [[Google Scholar](#)], [[Publisher](#)]
- [17] S. Ghosh, S. Kamalasan, N. Senroy, J. Enslin. *IEEE Transactions on Power Systems*, v.31, 2016, p. 1861-1871. [[crossref](#)], [[Google Scholar](#)], [[Publisher](#)]
- [18] E.A. Mahdiraji, *CRPASE: Transactions of Electrical, Electronic and Computer Engineering* **2020**, 6, 245-250. [[crossref](#)], [[Google Scholar](#)], [[Publisher](#)]
- [19] M.F.M. Arani, Y.A.R.I. Mohamed, in *IEEE Transactions on Energy Conversion*, **2016**, 31, 174-186. [[crossref](#)], [[Google Scholar](#)], [[Publisher](#)]
- [20] A. Bozorgian, Z.A. Aboosadi, A. Mohammadi, B. Honarvar, A. Azimi, *Prog. Chem. and Biochem. Res.*, **2020**, 3, 31-38. [[crossref](#)], [[Google Scholar](#)], [[Publisher](#)]

- [21] M.F.M. Arani, Y.A.R.I. Mohamed, *IEEE Trans. Power Systems*, **2015**, *30*, 385-396. [[crossref](#)], [[Google Scholar](#)], [[Publisher](#)]
- [22] A. Bozorgian, *Journal of Engineering in Industrial Research*, **2021**, *2*, 90-94. [[crossref](#)], [[Google Scholar](#)], [[Publisher](#)]
- [23] A. Bozorgian, *Progress in Chemical and Biochemical Research*, **2021**, *4*, 207-219. [[crossref](#)], [[Google Scholar](#)], [[Publisher](#)]
- [24] E.A. Mahdiraji, N. Ramezani, *International Academic Journal of Science and Engineering*, **2016**, *3*, 1-12. [[crossref](#)], [[Google Scholar](#)], [[Publisher](#)]
- [25] A. Bozorgian, S. Zarinabadi, A. Samimi, *Journal of Chemical Reviews*, **2020**, *2*, 122-129. [[crossref](#)], [[Google Scholar](#)], [[Publisher](#)]
- [26] S.E. Mousavi, A. Bozorgian, *International Journal of New Chemistry*, **2020**, *7*, 195-219. [[crossref](#)], [[Google Scholar](#)], [[Publisher](#)]
- [27] E. A. Mahdiraji, N. Ramezani, "Transient modeling of transmission lines components with respect to corona phenomenon and grounding system to reduce the transient voltages caused by lightning Impulse," 2015 2nd International Conference on Knowledge-Based Engineering and Innovation (KBEI), Tehran, Iran, **2015**, 405-411. [[crossref](#)], [[Google Scholar](#)], [[Publisher](#)]
- [28] M. Debouza, A. Al-Durra, "Grid ancillary services from doubly fed induction generator-based wind energy conversion system: A review", *IEEE Access*, **2019**, *7*, 7067-7081. [[crossref](#)], [[Google Scholar](#)], [[Publisher](#)]
- [29] N. Kayedi, A. Samimi, M. Asgari Bajgirani, A. Bozorgian, *South African Journal of Chemical Engineering*, **2021**, *35*, 153-158. [[crossref](#)], [[Google Scholar](#)], [[Publisher](#)]
- [9] E.A. Mahdiraji, *Journal of Chemical Reviews*, **2020**; *3*, [[crossref](#)], [[Google Scholar](#)], [[Publisher](#)]
- [30] E.A. Mahdiraji, M.S. Amiri, *Journal of Engineering in Industrial Research*, **2021**, *2*, 7-16. [[crossref](#)], [[Google Scholar](#)], [[Publisher](#)]
- [31] S.S. Guggilam, C. Zhao, E. Dall'Anese, Y.C. Chen, S.V. Dhople, *IEEE Trans. Power Syst.*, **2018**, *33*, 3076-3086. [[crossref](#)], [[Google Scholar](#)], [[Publisher](#)]
- [32] M.E. Bidhendi, Z. Asadi, A. Bozorgian, A. Shahhoseini, M.A. Gabris, *Environmental Progress & Sustainable Energy*, **2020**, *39*, 13306. [[crossref](#)], [[Google Scholar](#)], [[Publisher](#)]
- [33] M. Garmroodi, G. Verbic, D.J. Hill, *IEEE Transactions on Sustainable Energy*, **2018**, *9*, 676-684. [[crossref](#)], [[Google Scholar](#)], [[Publisher](#)]
- [34] A. Teninge, C. Jecu, D. Roye, S. Bacha, J. Duval, R. Belhomme, *IET Renew. Power Gener.*, **2009**, *3*, 358-370. [[crossref](#)], [[Google Scholar](#)], [[Publisher](#)]
- [35] A. Bozorgian, *Journal of Engineering in Industrial Research*, **2020**, *1*, 1-19. [[crossref](#)], [[Google Scholar](#)], [[Publisher](#)]
- [36] A. Mitra, D. Chatterjee, *IEEE Trans. Power Syst.*, **2016**, *31*, 82-93. [[crossref](#)], [[Google Scholar](#)], [[Publisher](#)]
- [37] A. Bozorgian, *Progress in Chemical and Biochemical Research*, **2020**, *3*, 169-179. [[crossref](#)], [[Google Scholar](#)], [[Publisher](#)]
- [38] C. Wu, Y. Jiao, H. Nian, F. Blaabjerg, in *IEEE Transactions on Power Electronics*, **2020**, *35*, 5562-5566. [[crossref](#)], [[Google Scholar](#)], [[Publisher](#)]
- [39] E.A. Mahdiraji, M.S. Amiri, *Journal of Engineering in Industrial Research*, **2020**, *1*, 111-122. [[crossref](#)], [[Google Scholar](#)], [[Publisher](#)]
- [40] K.V. Vidyanandan, N. Senroy, *IEEE Trans. Power Syst.*, **2013**, *28*, 837-846. [[crossref](#)], [[Google Scholar](#)], [[Publisher](#)]
- [41] I.D. Margaris, S.A. Papathanassiou, N.D. Hatziargyriou, *IEEE Trans. Sustain. Energy*, **2012**, *3*, 189-199. [[crossref](#)], [[Google Scholar](#)], [[Publisher](#)]